


SERVICE AREA MAP
EAST LOS ANGELES DISTRICT

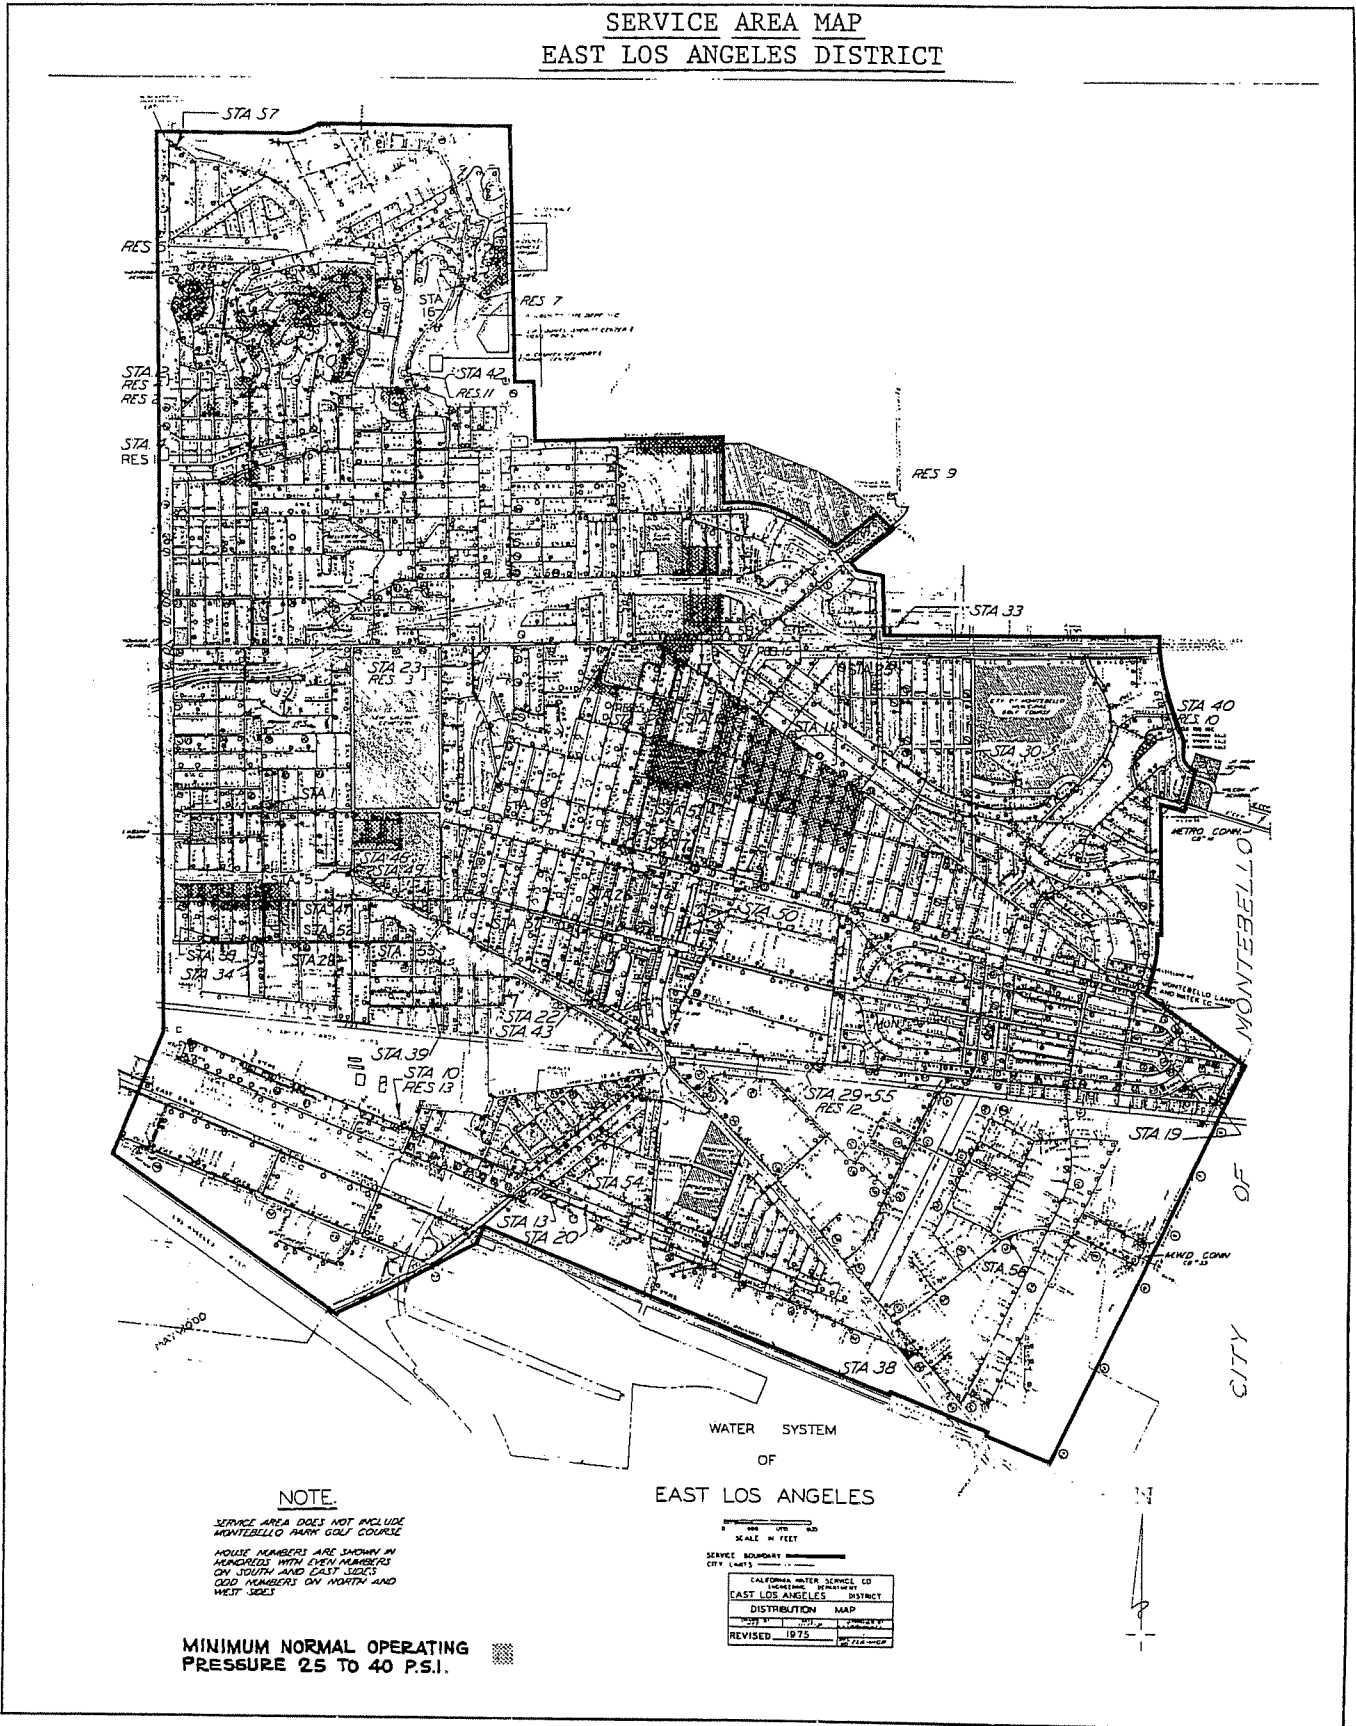

NOTE:

SERVICE AREA DOES NOT INCLUDE
MONTEBELLO PARK GOLF COURSE
HOUSE NUMBERS ARE SHOWN IN
HUNDREDS WITH EVEN NUMBERS
ON SOUTH AND ODD NUMBERS
ON NORTH AND WEST SIDES

MINIMUM NORMAL OPERATING
PRESSURE 25 TO 40 P.S.I.

WATER SYSTEM
OF
EAST LOS ANGELES

SCALE IN FEET
1" = 200'

SERVICE BOUNDARY
CITY LIMITS

| | |
|------------------------------|------------------------|
| CALIFORNIA WATER SERVICE CO. | ENGINEERING DEPARTMENT |
| EAST LOS ANGELES DISTRICT | |
| DISTRIBUTION MAP | |
| DATE: 1975 | BY: [Signature] |
| REVISED: 1975 | NO. 714-1000 |

Issued by

Ed F. Catey

ED F. CATEY, Vice President

Advice Letter No. 493

Decision No. 84334

Date Filed JUL 4 1976

Effective JUN 9 1976

Resolution No.